


3.5m

6m

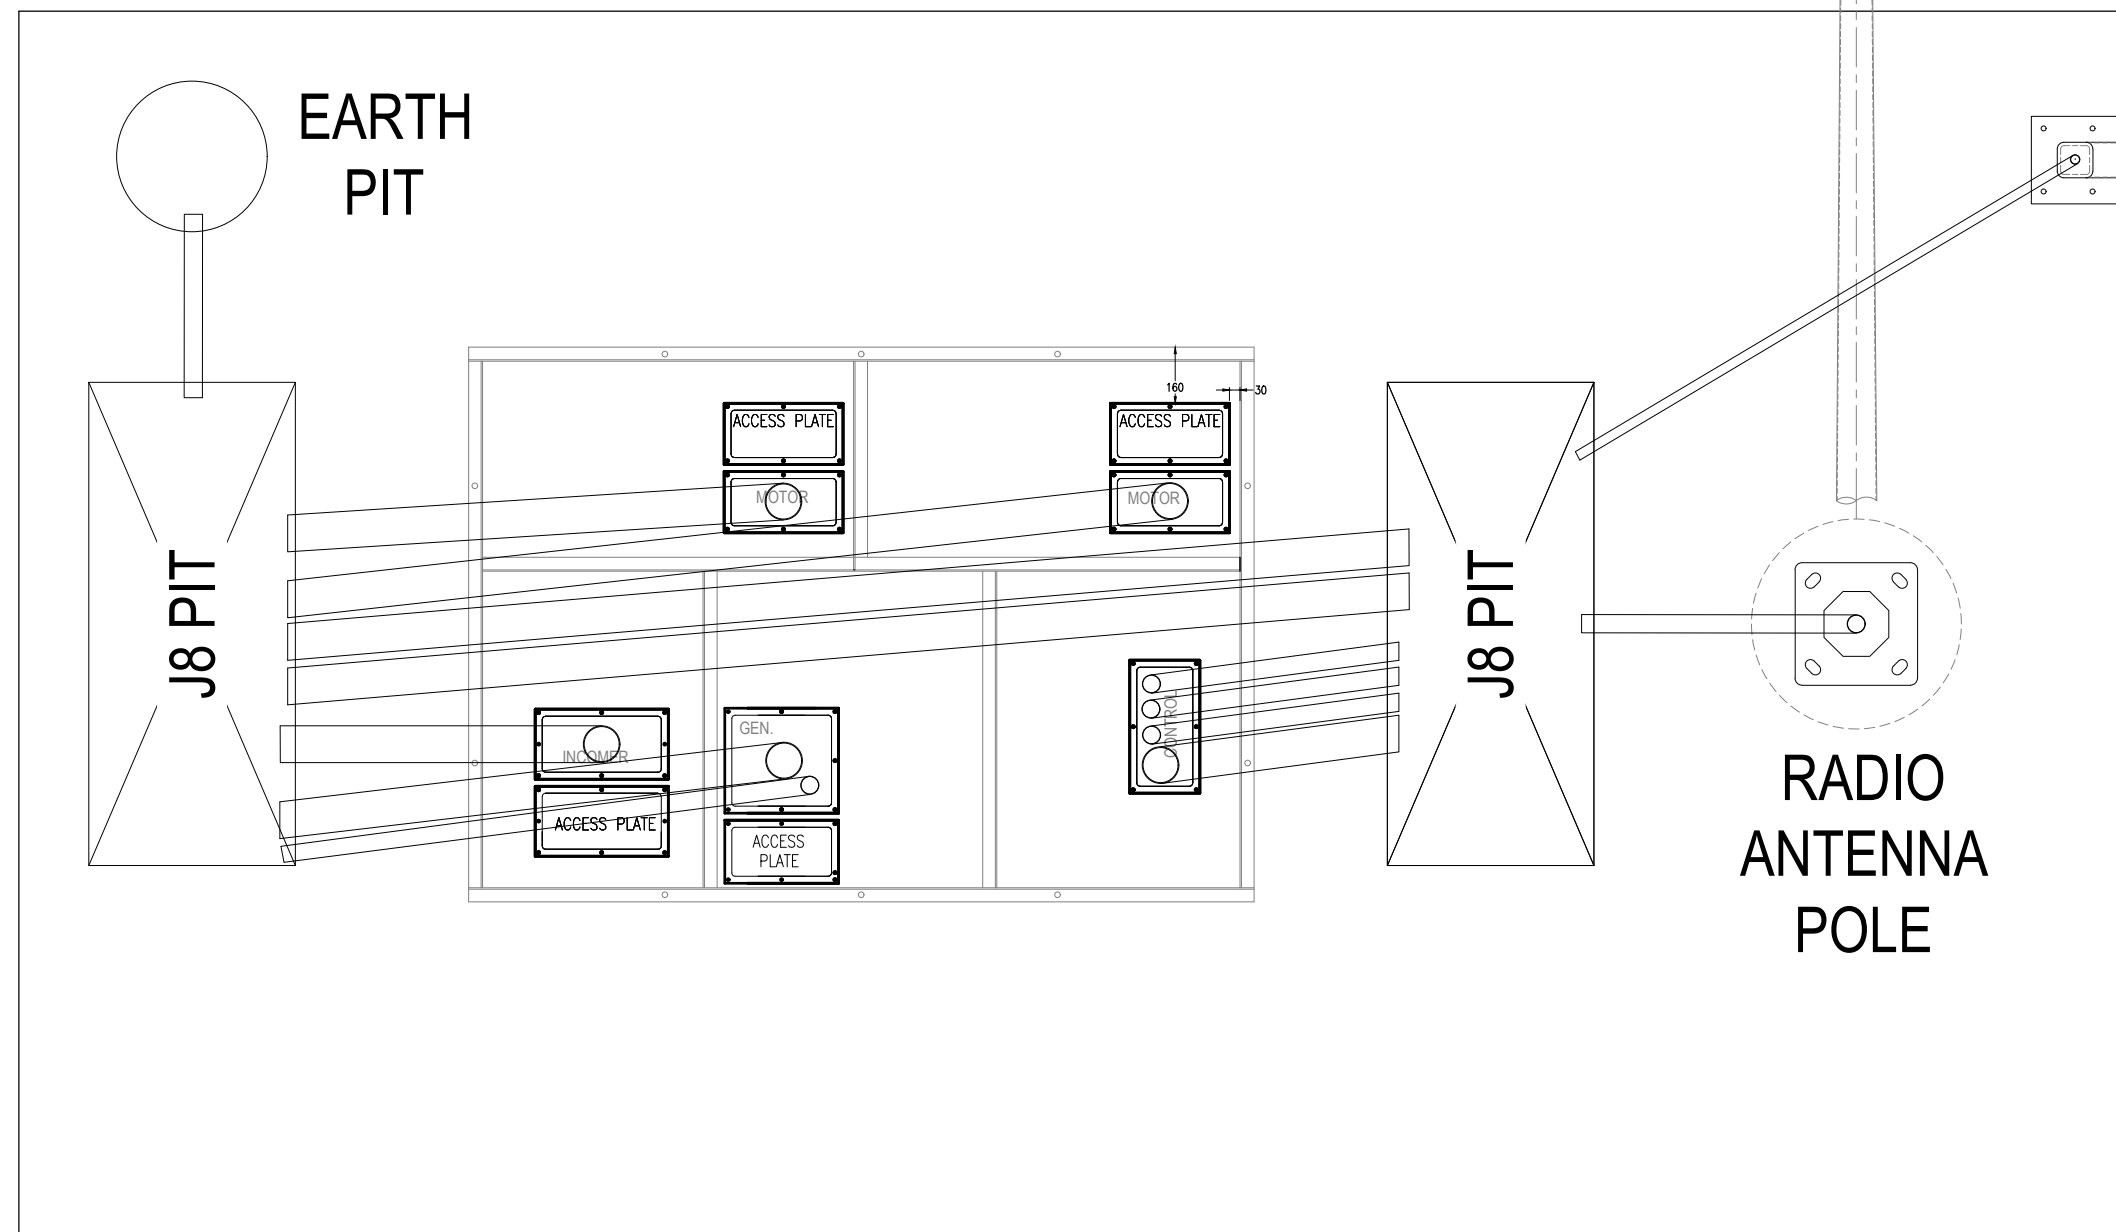

TYPICAL CONDUIT LAYOUT

AMENDMENTS			
REV	DESCRIPTION	CHECKED	DATE
0	ISSUED FOR REFERENCE		

PRINTED ON Friday, 8 August 2025 3:23:41 PM BY Roseben Enriquez



GLADSTONE REGIONAL COUNCIL

P.O. Box 29, Gladstone Qld. 4680

STANDARD DRAWING
DUAL SEWERAGE PUMP STATION
SWITCHBOARD 22-160KW VSD
BOARD AND PANEL LABELS - SHEET 3 OF 3

DRAWING NO.		
GRC-ED-129		
A1 SHEET	REVISION	0