




×ALL DIMENSIONS ARE FOR GUIDANCE PURPOSE ONLY. THE MANUFACTURER MUST VERIFY THEIR SWITCHBOARD AS PER AS/NZS 61439 REQUIREMENT WHEN APPLICABLE AND AS PER AS/NZS 3000-2018 AND ALL THE RELEVANT STANDARDS AND LOCAL REGULATIONS, QECM AND MIRS.

AMENDMENTS			
REV	DESCRIPTION	CHECKED	DATE
0	ISSUED FOR REFERENCE		

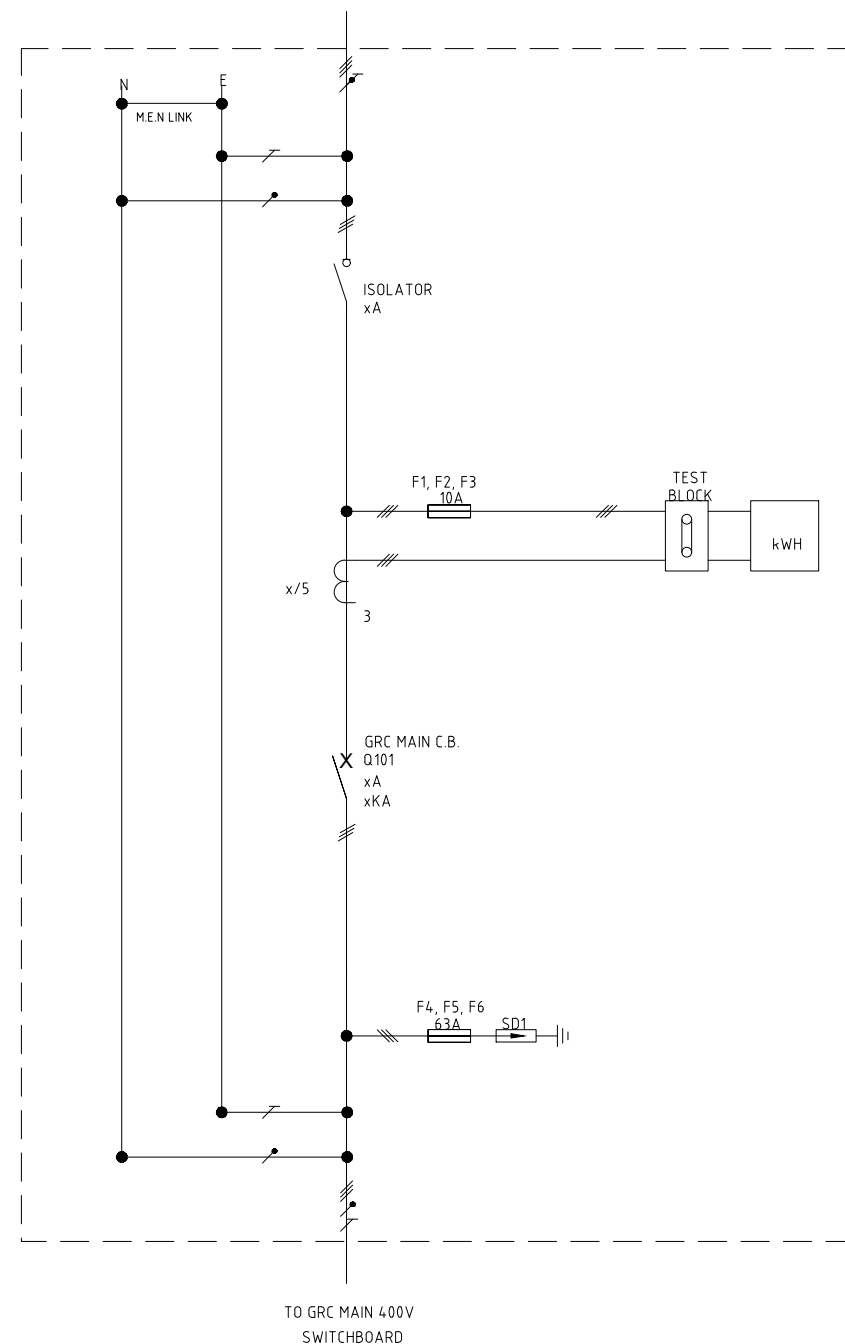

GLADSTONE REGIONAL COUNCIL
P.O. Box 29, Gladstone Qld. 4680

STANDARD DRAWING
DUAL SEWERAGE PUMP STATION
SWITCHBOARD 22-160KW VSD
SINGLE LINE DIAGRAM

DRAWING NO.
GRC-ED-130

A1 SHEET	REVISION	0
----------	----------	---